

# IVA-AE2 Response Time Distribution - Extended Test


Name: Doe, Jane

Test Date: 8/16/2015 9:22 AM

Age: 21

Sex: F


Auditory Response Validity Check: Valid

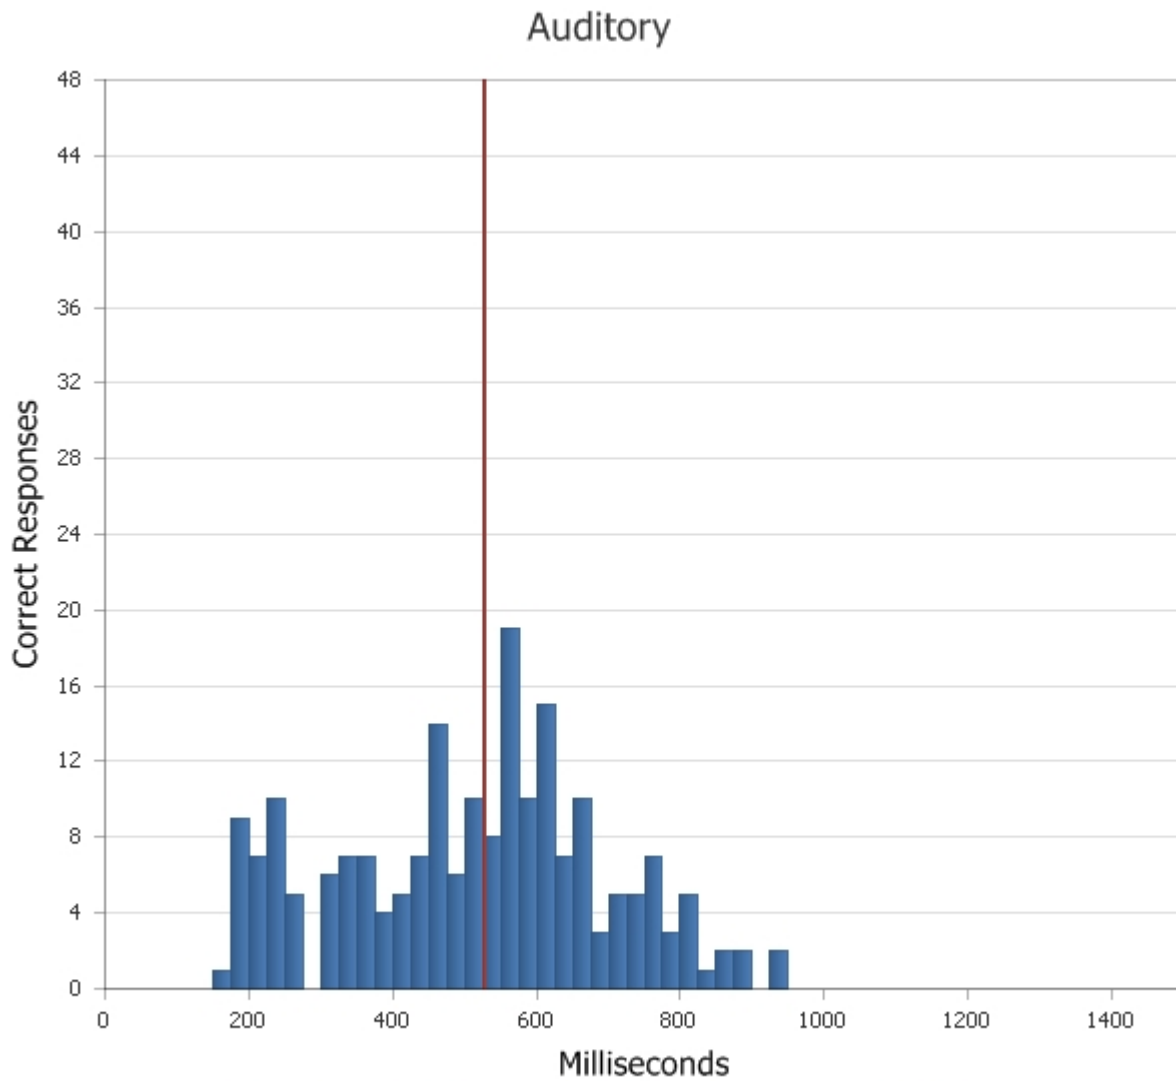

Red line indicates mean reaction time from normative database.

**Accurate Responses:** 202/250 (A single click to a target greater than 125 ms)  
**1st Quartile:** 370 ms  
**Mean:** 511 ms  
**3rd Quartile:** 631 ms  
**Standard Deviation:** 185 ms

Visual Response Validity Check: Valid

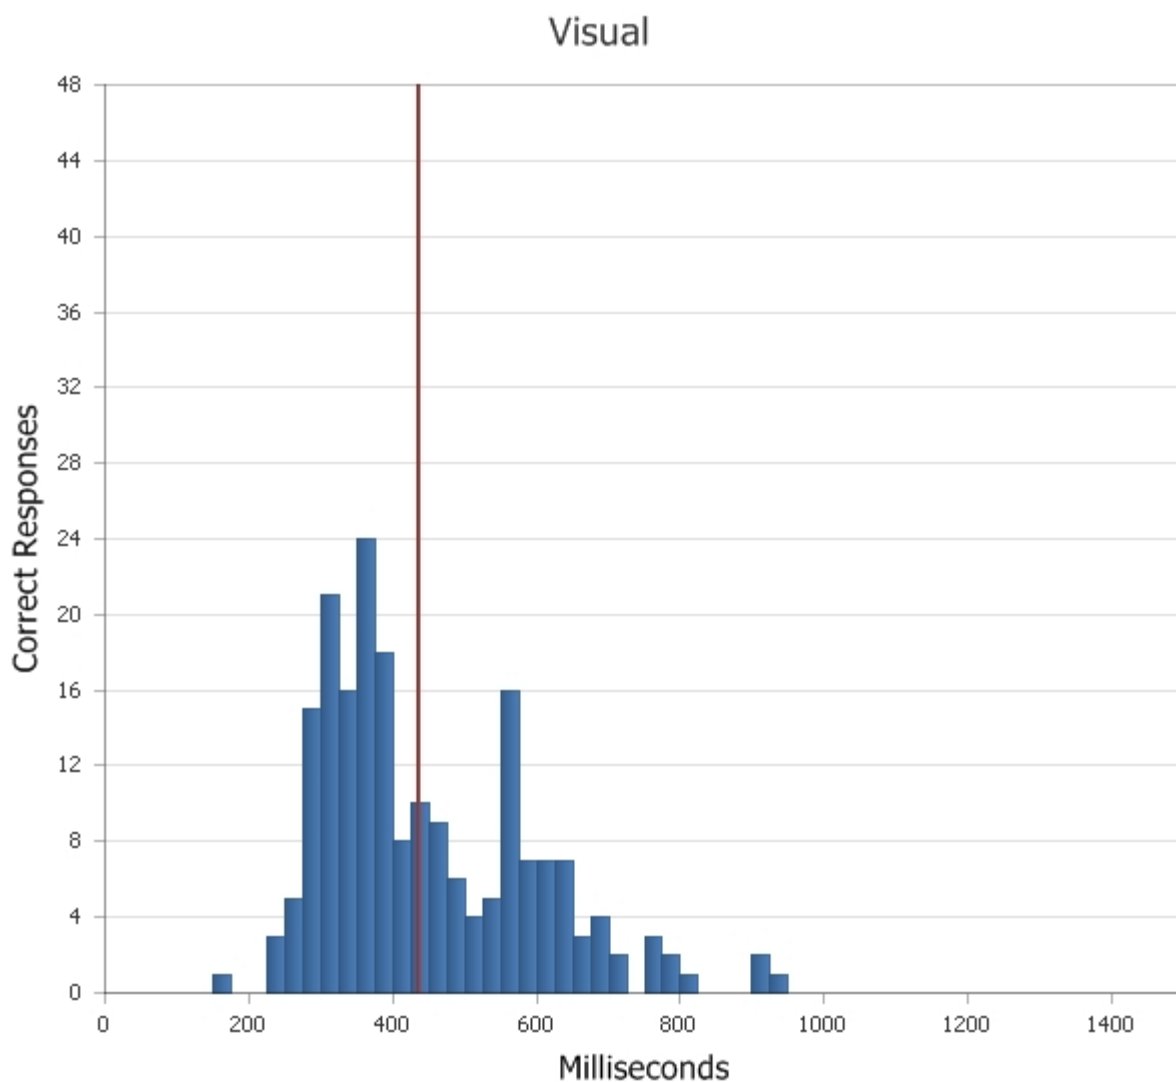

Red line indicates mean reaction time from normative database.

**Accurate Responses:** 200/250 (A single click to a target greater than 125 ms)  
**1st Quartile:** 331 ms  
**Mean:** 443 ms  
**3rd Quartile:** 551 ms  
**Standard Deviation:** 147 ms